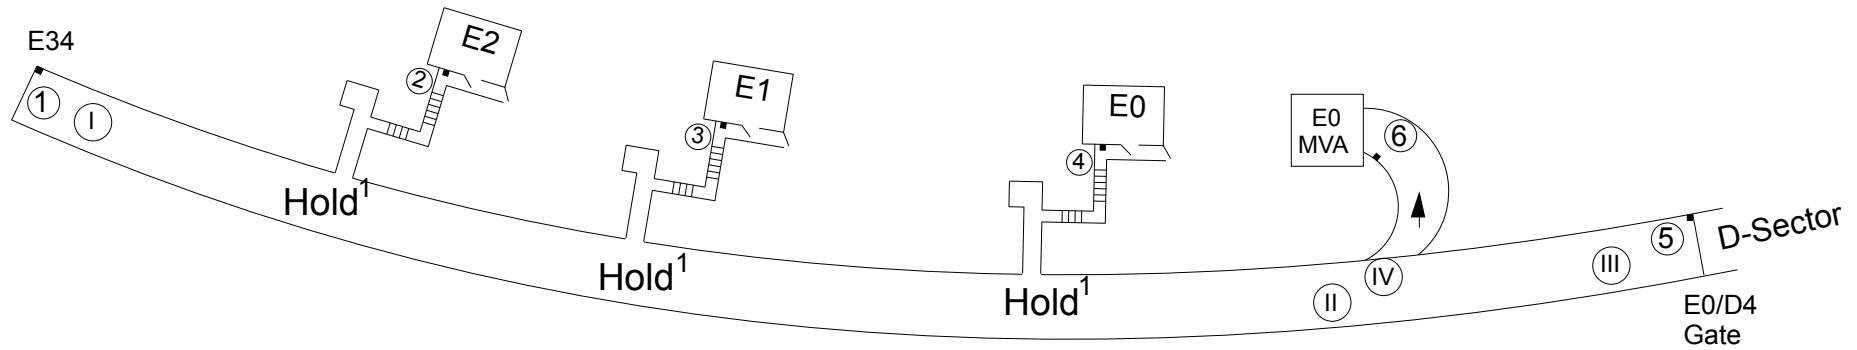# E-Sector

I.   "A" and "B" reset Interlock box #1.
II. "A" holds.
III. "B" resets Interlock box #5.
IV. "B" joins "A" and they continue to E0 MVA, reset
     Interlock box #6, and control access out. (They can
     continue the Search and Secure by control accessing
     into D-Sector.

Hold[1] - "B" waits while "A" checks the stairwell
          and resets the Interlock box at the service
          building.